



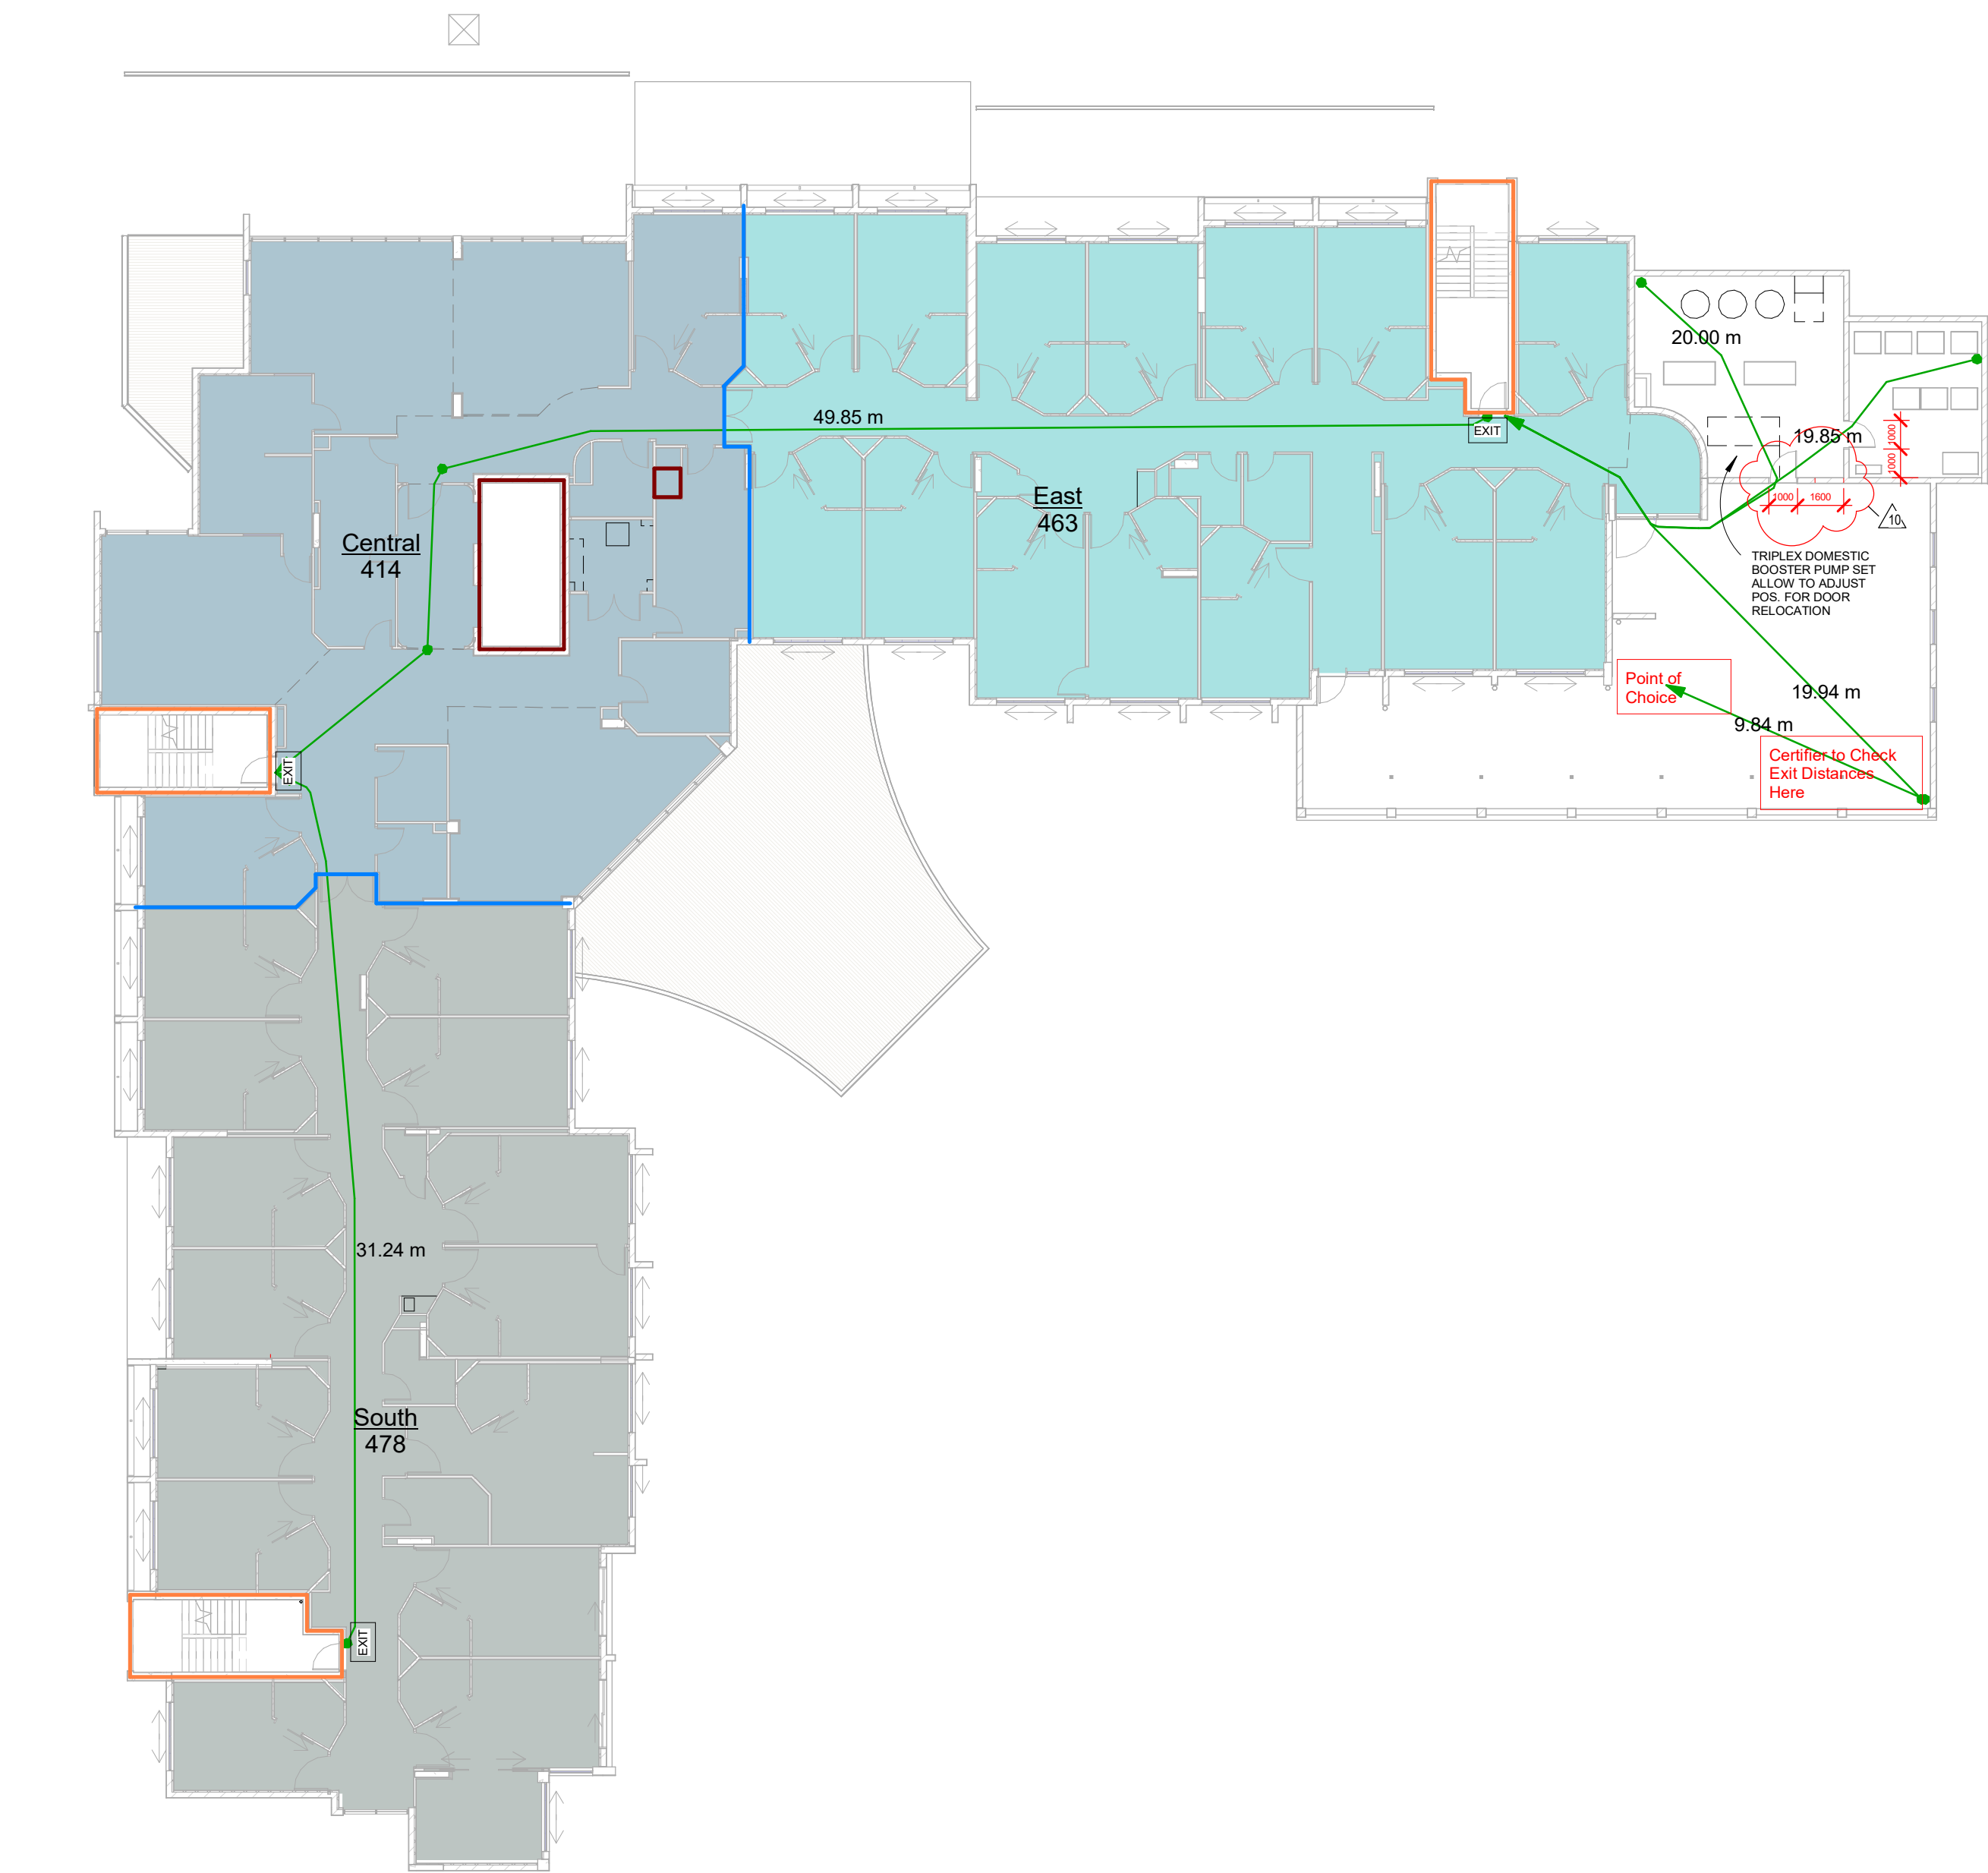

1 Compartmentation - L1
1 : 200

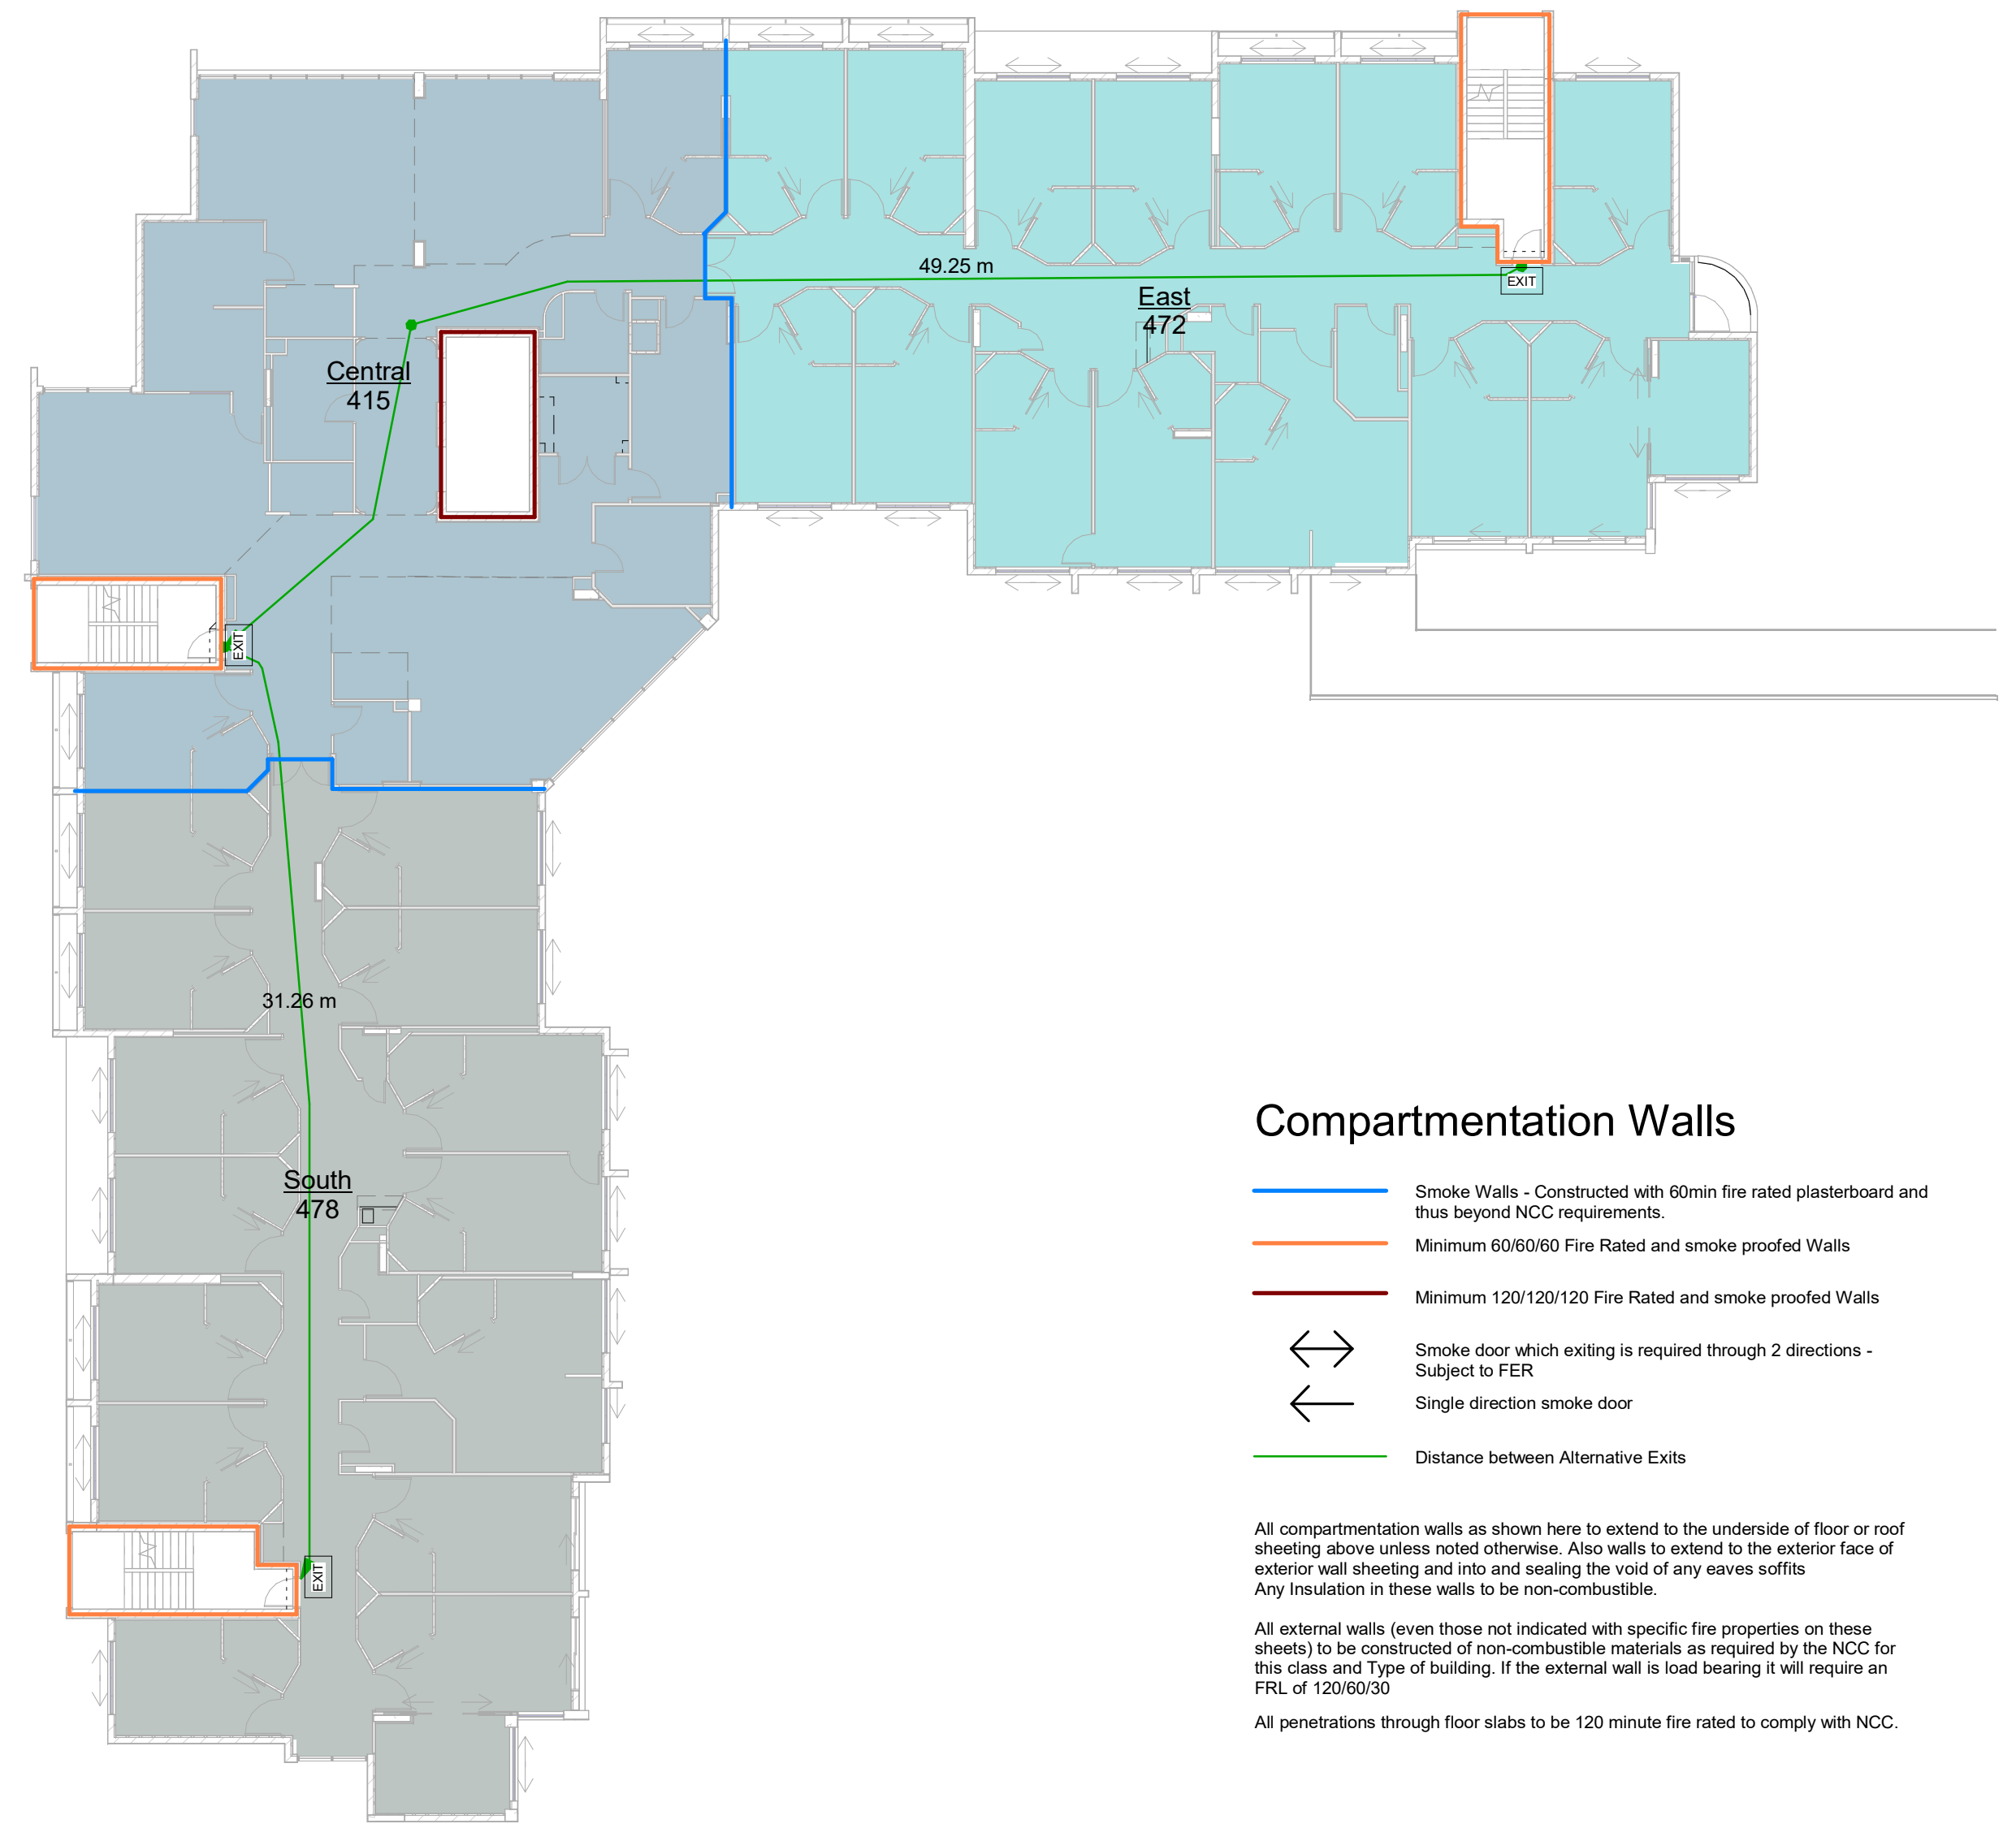

2 Compartmentation - L2
1 : 200

Compartmentation Walls

- Smoke Walls - Constructed with 60min fire rated plasterboard and thus beyond NCC requirements.
- Minimum 60/60/60 Fire Rated and smoke proofed Walls
- Minimum 120/120/120 Fire Rated and smoke proofed Walls
- Smoke door which exiting is required through 2 directions - Subject to FER
- Single direction smoke door
- Distance between Alternative Exits

All compartmentation walls as shown here to extend to the underside of floor or roof sheeting above unless noted otherwise. Also walls to extend to the exterior face of exterior wall sheeting and into and sealing the void of any eaves soffits. Any Insulation in these walls to be non-combustible.

All external walls (even those not indicated with specific fire properties on these sheets) to be constructed of non-combustible materials as required by the NCC for this class and Type of building. If the external wall is load bearing it will require an FRL of 120/60/30

All penetrations through floor slabs to be 120 minute fire rated to comply with NCC.

GJG Architects

ABN 69 637 879 228
PO Box 1173
Elanora QLD 4221
Telephone (07) 5520 1134



Project
Pelican Waters ACF

Client
Rockpool

Issue	Date	Amendment
10	29.11.22	Level 1 podium services access door repos. re exit distances
9	17.08.22	IFC gen updates per other or more detailed plans
8	6.12.21	Tender Issue
7	2.11.21	Prelim DD Issue 2 - Struct Update
6	18.10.21	Prelim DD Issue 1
5	30.09.21	Prelim 4
4	1.07.21	SD Revised
3	21.06.21	SD Issue

Drawing Title	Drawing Number
L1 & L2- Compartmentation	20-12-A-1.31
Scale 1 : 200 @ A1 original	

The design and drawings for this project remains
the copyright of MPC Architecture Pty. Ltd. ACN 637879228