

EROSION AND SEDIMENT CONTROL NOTES

GENERAL INSTRUCTIONS

1. THIS PLAN IS TO BE READ IN CONJUNCTION WITH THE ENGINEERING PLANS, LANDSCAPING PLANS AND WRITTEN INSTRUCTIONS RELATING TO THE SUBJECT DEVELOPMENT.
2. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO CONTROL EROSION AND DOWNSTREAM SEDIMENTATION DURING ALL STAGES OF CONSTRUCTION INCLUDING THE MAINTENANCE PERIOD.
3. THE EXTENT AND POSITION OF THE EROSION AND SEDIMENT CONTROL MEASURES TO BE DETERMINED ON SITE BY THE CONTRACTOR TO SUIT THE CONSTRUCTION PROGRAM.
4. THESE PLANS PRESENT CONCEPTS ONLY AND THE MEASURES SHOWN ON THIS DRAWING(S) ARE MINIMUM REQUIREMENTS ONLY.
5. THE CONTRACTOR SHALL AT ALL TIMES BE RESPONSIBLE FOR THE ESTABLISHMENT, MANAGEMENT AND MAINTENANCE OF THE EROSION AND SEDIMENT CONTROL MEASURES TO MEET COUNCIL STANDARDS.
6. LARGE OPEN AREAS OR STEEP BATTERS SHOULD NOT BE LEFT EXPOSED/UNSTABILISED FOR MORE THAN 10 DAYS OR IF WET WEATHER IS FORECAST.
7. EXPOSED AREAS INCLUDING BATTERS WHICH REMAIN UN-WORKED FOR MORE THEN 10 DAYS SHOULD BE STABILISED USING TEMPORARY HYDROMULCHING, HYDROSEEDING OR MULCHING, EVEN IF AREAS WILL BE WORKED AT A LATER TIME.
8. ALL WORKS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE LATEST VERSION OF THE INSTITUTION OF ENGINEERS AUSTRALIA, 'SOIL EROSION AND SEDIMENT CONTROL - ENGINEERING GUIDELINES FOR QUEENSLAND CONSTRUCTION SITES'.
9. THE CONTRACTOR SHALL BE AWARE OF ITS RESPONSIBILITIES FOR PROTECTING THE DOWNSTREAM ENVIRONMENT AND RECEIVING WATER FROM POLLUTION AND ENVIRONMENTAL HARM, UNDER THE ENVIRONMENTAL PROTECTION ACT, 1994.
10. ADDITIONALLY THE CONTRACTOR SHALL BE AWARE OF ITS DUTY TO NOTIFY THE LOCAL AUTHORITY AND THE ENVIRONMENTAL PROTECTION AGENCY (QLD) OF A POTENTIAL OR ACTUAL INCIDENT OF ENVIRONMENTAL HARM, UNDER THE ENVIRONMENTAL PROTECTION ACT, 1994.

RECOMMENDED IMPLEMENTATION SEQUENCE:

1. ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE INSTALLED AND FUNCTIONAL PRIOR TO WORKS COMMENCING AND IN THE FOLLOWING SEQUENCE.
- a. CONSTRUCT TEMPORARY STABILISED SITE ACCESS, ENSURING ADJACENT STORMWATER RUN OFF IS DIVERTED AWAY FROM ACCESS
- b. INSTALL SEDIMENT FENCING AND/OR BARRIER FENCING TO CONFINE INGRESS TO AND EGRESS FROM THE SITE TO STABILISED ACCESS POINT(S) ONLY.
- c. PROVIDE INLET PROTECTION TO STORMWATER INLETS AND GULLIES ON ALL ROADS ADJOINING THE SITE.
- d. CONSTRUCT BARRIER FENCING AROUND RESTRICTED 'NO-GO' ZONES OF RETAINED VEGETATION, AREAS NOT TO BE DISTURBED AND AREAS WHICH WILL REMAIN UN-WORKED.
- e. CONSTRUCT UPSTREAM DIVERSION CHANNELS TO DIVERT CLEAN WATER AROUND WORKSITE, AND INSTALL APPROPRIATE CHANNEL STABILISATION.
- f. CONSTRUCT LOW FLOW EARTH BANKS AS CATCH DRAINS PARALLEL TO CONTOURS TO LIMIT LARGE SLOPE LENGTHS (SLOPES SHOULD BE LESS THEN 80M IN LENGTH).
- g. INSTALL ALL TEMPORARY SEDIMENT FENCES.
- h. CONSTRUCT ANY NOMINATED SEDIMENT BASINS AND SEDIMENT TRAPS.
- i. STABILISE ALL DISTURBED AREAS ASAP AND PROGRESSIVELY AS WORKS ARE COMPLETED. TEMPORARY STABILISATION TO BE DONE USING MULCHING, HYDROMULCHING, HYDROSEEDING OR DIRECT SEEDING TO GIVE A 70% COVERAGE OF GROUND SURFACE WITHIN 14 DAYS OF WORKS COMPLETING (EVEN IF WORKS MAY CONTINUE LATER).
2. UNDERTAKE SITE DEVELOPMENT WORKS SO THAT LAND DISTURBANCE IS CONFINED TO MINIMUM WORKABLE AREAS.
3. DISTURBED AREAS TO EXTEND NO MORE THAN 5 METRES (PREFERABLY 2 METRES) FROM ESSENTIAL WORKS AREAS.
4. WORK AREAS TO BE DELINEATED BY BARRIER FENCING AND DIVERSION CHANNEL UPSLOPE AND SEDIMENT FENCING DOWNSLOPE.
5. THE CONTRACTOR SHALL ENSURE THAT THE EXISTING VEGETATION AND GROUND COVER IS RETAINED AS MUCH AS POSSIBLE.
6. TOPSOIL SHALL BE STRIPPED AND STOCKPILED FOR LATER USE ON SITE.
7. NATIVE SITE VEGETATION REQUIRED AND APPROVED FOR CLEARING SHOULD BE MULCHED AND STOCKPILED FOR LATER USE IN LANDSCAPING, STABILISATION AND/OR SITE REHABILITATION WORKS.
8. AT ALL TIMES THE CONTRACTOR SHALL MONITOR THE PREVAILING WEATHER CONDITIONS AND PROTECT ANY DOWNSTREAM CONSTRUCTION AND RECEIVING ENVIRONMENTS.
9. EROSION AND SEDIMENT CONTROL PROTECTION MEASURES SHALL BE MAINTAINED BY THE CONTRACTOR THROUGHOUT CONTRACT.
10. PLANS AND CONTROL MEASURES FOR LARGE SITES WILL NEED TO BE REVISED AND UPDATED TO REFLECT THE SITE STAGES AND PROGRESSION OF WORKS.
11. MEASURES INCLUDING SEDIMENT FENCES SHOULD BE MOVED AND REINSTATED AS WORKS PROGRESS.

12. FOOT AND VEHICULAR TRAFFIC TO BE RESTRICTED IN RECENTLY STABILISED AREAS INCLUDING THOSE HYDROSEEDED, TURFED OR SEEDDED.

CONTROL MEASURES

1. FINAL SITE LANDSCAPING SHALL BE UNDERTAKEN AS SOON AS POSSIBLE AND WITHIN 10 WORKING DAYS OF CONSTRUCTION COMPLETION
2. SEDIMENT LADEN WATER SHALL BE PREVENTED FROM ENTERING THE PERMANENT DRAINAGE SYSTEM BY USING INLET PROTECTION.
3. ALL PERIMETER BANKS AND CHANNEL DRAINS SHALL HAVE UNINTERRUPTED POSITIVE GRADE TO AN OUTLET.
4. ALL TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES SHALL ONLY BE REMOVED ONCE SITE IS STABILISED AND UPSTREAM WORKS HAVE BEEN COMPLETED.
5. AT CONSTRUCTION COMPLETION ALL TEMPORARY EARTH STRUCTURES, INCLUDING SOIL STOCKPILES ARE TO BE TRACK ROLLED AND SEEDDED. THE CONTRACTOR IS TO ENSURE A 70% COVERAGE WITHIN 14 DAYS.

DUST CONTROL

1. DURING WINDY AND DRY WEATHER ANY UNPROTECTED AREAS SHALL BE KEPT MOIST (NOT WET) BY SPRINKLING WITH WATER TO KEEP DUST UNDER CONTROL. WHERE WATER IS NOT AVAILABLE IN SUFFICIENT QUANTITIES, SOIL BINDERS OR DUST RETARDANTS TO BE USED FOR DUST SUPPRESSION.
2. EXPOSED SURFACES INCLUDING BATTERS SHOULD BE LEFT ROUGH TO REDUCE WIND SPEEDS AND POTENTIAL FOR WIND EROSION.
3. USE OPEN WEAVE BARRIER FENCING ON WINDWARD SIDE OF SITE IF REQUIRED (REFER DETAIL). FENCING IS GENERALLY REQUIRED WHERE AREA OF DISTURBANCE IS >5000m².

OTHER MATTERS

1. ACCEPTABLE RECEPTORS AND DISPOSAL PRACTICES WILL BE USED FOR CONCRETE AND MORTAR SLURRIES, PAINTS, ACID WASHERS, LITTER AND GENERAL WASTE MATERIALS.
2. ANY EXISTING TREES WHICH ARE NOT REQUIRED OR APPROVED TO BE CLEARED FOR THE WORKS AND/OR FORM PART OF THE FINAL LANDSCAPING PLAN SHOULD BE PROTECTED FROM CONSTRUCTION ACTIVITIES BY:
- a. PROTECTING THEM WITH BARRIER FENCING OR MARKERS.
- b. ENSURING NOTHING IS NAILED TO THEM
- c. PROHIBITING PAVING, GRADING OR PLACING OF STOCKPILES WITHIN DRIP LINE.
3. ALL VEHICLE AND EQUIPMENT WASHING SHOULD BE CONTAINED IN SPECIFIC BUNDED AREAS, DISCONNECTED FROM CONCENTRATED FLOW PATHS AND THE STORMWATER SYSTEM.
4. ANY NECESSARY VEHICLE OR EQUIPMENT REFUELING SHOULD BE UNDERTAKEN AWAY FROM CONCENTRATED FLOW PATHS AND PREFERABLY WITHIN A BUNDED AREA.
5. ANY ONSITE FUEL STORAGE AREAS SHOULD BE COVERED AND BUNDED.

MAINTENANCE OF PUBLIC ROADS

1. ALL CONSTRUCTION VEHICLES DEPARTING FROM THE SITE SHALL HAVE THEIR TYRES WASHED DOWN OR SEDIMENT REMOVED BY A STABILISED SITE ACCESS DEVICE.
2. THE STABILISED SITE ACCESS AREAS SHALL BE LOCATED SUCH THAT SILTED WATER IS FILTERED THROUGH A SUITABLE SEDIMENT TRAP (SUCH AS A SEDIMENT FENCE) INSTALLED DOWNSTREAM OF ACCESS.
3. THE CONTRACTOR SHALL INSPECT THE PUBLIC ROADS ADJACENT TO THE SITE DAILY AND MANUALLY REMOVE ANY SEDIMENT DEPOSITS (BY SWEEPING NOT WASH DOWN).

SITE INSPECTION AND MAINTENANCE

1. ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE INSPECTED REGULARLY, IMMEDIATELY BEFORE SITE CLOSURE, PRIOR TO PREDICTED LARGE STORM EVENTS AND AFTER EVERY SIGNIFICANT (> 5MM) RAINFALL EVENT OR AT LEAST ON A WEEKLY BASIS.
2. THE CONTRACTOR WILL AS A MINIMUM CONDUCT EACH INSPECTION IN LINE WITH THE FOLLOWING
- a. RECORD TYPE OF DEVICE/CONTROL MEASURE BEING INSPECTED AND ITS LOCATION;
- b. RECORD THE CONDITION OF EVERY CONTROL MEASURE;
- c. RECORD MAINTENANCE REQUIREMENTS FOR EVERY CONTROL DEVICE;
- d. RECORD SEDIMENT VOLUMES REMOVED FROM SEDIMENT TRAPPING DEVICES;
- e. RECORD DETAILS OF SEDIMENT BASIN TREATMENT, FLOCCULANT DOSAGE AND CLEANOUT;
- f. RECORD SEDIMENT DISPOSAL PROCEDURES AND LOCATION.
3. REPAIRS AND MAINTENANCE OF ALL DEVICES AND MEASURES INCLUDING DIVERSION CHANNELS SHALL BE UNDERTAKEN AS REQUIRED, ENSURING ALL MEASURES ARE FULLY FUNCTIONAL AT ALL TIMES.
4. ENSURE SEDIMENT LADEN WATER HAS NOT BEEN DIVERTED AROUND DEVICES.
5. REPAIR SCOUR DAMAGE TO SEDIMENT CONTROL MEASURES AFTER RAINFALL EVENTS AND REINSTATE DEVICES AS NECESSARY.
6. SEDIMENT FENCES WILL REQUIRE CLEANING WHEN SEDIMENT REACHES 300MM DEPTH OR ONE-HALF THE HEIGHT OF THE FILTER FABRIC AND ALL OTHER SEDIMENT TRAPS WILL REQUIRE CLEANING OUT WHEN 30% OF DESIGN CAPACITY IS REACHED.
7. ALL INLET AND GULLY TRAPS TO BE CLEANED NOT HOSED AFTER EVERY RAINFALL EVENT, (1>5mm) OR AT LEAST ON A WEEKLY BASIS.


8. SEDIMENT REMOVED FROM ANY TRAPPING DEVICE TO BE RELOCATED, ENSURING FURTHER POLLUTION TO DOWNSTREAM ENVIRONMENTS WILL NOT OCCUR.
9. ALL SEEDING, HYDROSEEDING AND TURFING REQUIRES REGULAR WATERING, UNTIL EFFECTIVE COVER ESTABLISHED AND PLANTS ARE GROWING VIGOROUSLY. WATERING SHOULD VARY DEPENDING ON WEATHER AND SOIL CONDITIONS.
10. WATERING SHOULD START IMMEDIATELY AFTER PLANTING AND SHOULD COMPLY WITH THE FOLLOWING AS A MINIMUM:
- WEEK 1 3 WATERINGS/WEEK
- WEEK 2-6 2 WATERINGS/WEEK
- WEEK 7-12 1 WATERING/WEEK
11. EXCESSIVE VEGETATION GROWTH WILL BE CONTROLLED THROUGH MOWING OR SLASHING.
12. IT IS THE CONTRACTORS RESPONSIBILITY TO ENSURE INSPECTION, MAINTENANCE AND TESTING OF DEVICES IS UNDERTAKEN ON SITE.
13. THE CONTRACTOR TO KEEP DETAILED AND LEGIBLE RECORDS OF ALL INSPECTION AND MAINTENANCE UNDERTAKEN ON THE EROSION AND SEDIMENT CONTROL DEVICES.
14. ALL SITE WASTE INCLUDING GENERAL RUBBISH TO BE DISPOSED OF IN AN ENVIRONMENTALLY RESPONSIBLE MANNER IN ACCORDANCE WITH THE ENVIRONMENTAL PROTECTION (WASTE MANAGEMENT) POLICY 2000 AND ENVIRONMENTAL PROTECTION (WASTE MANAGEMENT) REGULATION 2000.
15. THE CONTRACTOR SHALL CONSTRUCT AND IMPLEMENT ADDITIONAL MEASURES AS NECESSARY TO ENSURE PROTECTION OF DOWNSTREAM ENVIRONMENTS.

SEDIMENT BASIN MAINTENANCE

1. THE CONTRACTOR SHALL KEEP DETAILED AND ACCURATE RECORDS OF THE MONITORING, TREATMENT, TESTING AND MAINTENANCE OF THE SEDIMENT BASIN INCLUDING RECORDED RAINFALL VOLUME, FLOCCULATING AGENTS USED AND TEST RESULTS PRIOR TO DEWATERING.
2. THE STORMWATER RUNOFF COLLECTED IN THE SEDIMENT BASIN SHALL BE MONITORED, TREATED AND TESTED PRIOR TO DISCHARGE, INCLUDING WATER TO BE REUSED ON SITE.
3. WATER TESTING TO BE UNDERTAKEN BY A SUITABLY QUALIFIED PERSON.
4. ALL LABORATORY TESTING TO BE UNDERTAKEN BY A NATA ACCREDITED LABORATORY.
5. ALL WATER PUMPED FROM THE SEDIMENT BASIN SHALL BE TESTED FOR ENVIRONMENTAL COMPLIANCE AGAINST THE RELEASE CRITERIA IN THE TABLE BELOW (AS A MINIMUM), UNLESS ALTERNATIVE (MORE STRINGENT) STANDARDS ARE SPECIFIED BY THE LOCAL AUTHORITY PRIOR TO RELEASE.

PARAMETER	RELEASE CRITERIA
SUSPENDED SOLIDS	50mg/l MAX AND <10% INCREASE IN CONCENTRATION BETWEEN UPSTREAM AND DOWNSTREAM OF THE DEVELOPMENT SITE
pH	WITHIN RANGE 6.5 - 8.5
VISUAL AMENITY	NO VISUAL PLUME

6. WATER TESTING TO BE UNDERTAKEN USING EITHER A HANDHELD PH/TURBIDITY METER OR SAMPLES COLLECTED FOR LABORATORY TESTING PRIOR TO BASIN DEWATERING.
7. THE SEDIMENT BASIN SHALL BE TREATED BY FLOCCULATION AFTER ALL RAINFALL EVENTS (> 5MM) USING GYPSUM OR ALUM. MANUAL DOSAGE OF BASIN SHALL BE UNDERTAKEN USING A MINIMUM RATE OF 32kg/100m³ FOR GYPSUM AND 1.5-8kg/100m³ FOR ALUM. HIGHER DOSAGE MAY BE REQUIRED DEPENDING ON SOIL TYPE AND APPLICATION TECHNIQUE.
8. THE CHOSEN FLOCCULENT SHALL BE SPREAD EVENLY OVER THE BASIN SURFACE AREA. THE BASIN WILL REQUIRE A PUMP SYSTEM TO SPRAY SLURRY OF FLOCCULANTS OVER SURFACE AT AN ANGLE OF 10 - 20 DEGREES.
9. THE TREATED BASIN SHALL BE DEWATERED WITH A PUMP SYSTEM WITH A FLOATING INLET TO ENSURE SETTLED SEDIMENT IS NOT ENTRAINED AND DISCHARGED.
10. BASIN DEWATERING SHALL OCCUR WITHIN 5 DAYS FROM CONCLUSION OF RAINFALL EVENT.
11. SEDIMENT BASINS WILL REQUIRE DEWATERING AND SEDIMENT CLEANOUT ONCE STORAGE CAPACITY REACHES 70%.
12. CAPTURED SEDIMENT WILL BE DISPOSED OF IN AN ENVIRONMENTALLY RESPONSIBLE MANNER AS TO NOT CAUSE FURTHER CONTAMINATION OR DOWNSTREAM POLLUTION. SEDIMENT SHOULD NOT BE DISPOSED OF IN CONCENTRATED FLOWS, WHERE IT CAN BE RE-ENTRAINED OR WHERE THE RECEIVING WATER HAS A PH OF < 5.5.
13. THE BASIN AND ALL OTHER CONTROL DEVICES WILL BE MAINTAINED IN AN OPERATIONAL STATE UNTIL SITE STABILISED.
14. REPAIR ANY SCOUR DAMAGE TO THE SEDIMENT BASIN BATTERS AND EMERGENCY SPILLWAY FOLLOWING RAINFALL EVENTS.
15. SEDIMENT BASIN SHOULD NOT BE CONSTRUCTED WITH SMOOTH INTERNAL SLOPES AND BASIN BATTERS SHOULD NOT BE STEEPER THEN 3(H):1(V).
16. BASINS SHOULD BE APPROPRIATELY FENCED AND MARKED BY WARNING SIGNS IF UNSUPERVISED PUBLIC ACCESS IS LIKELY AND PUBLIC SAFETY IS AT RISK.

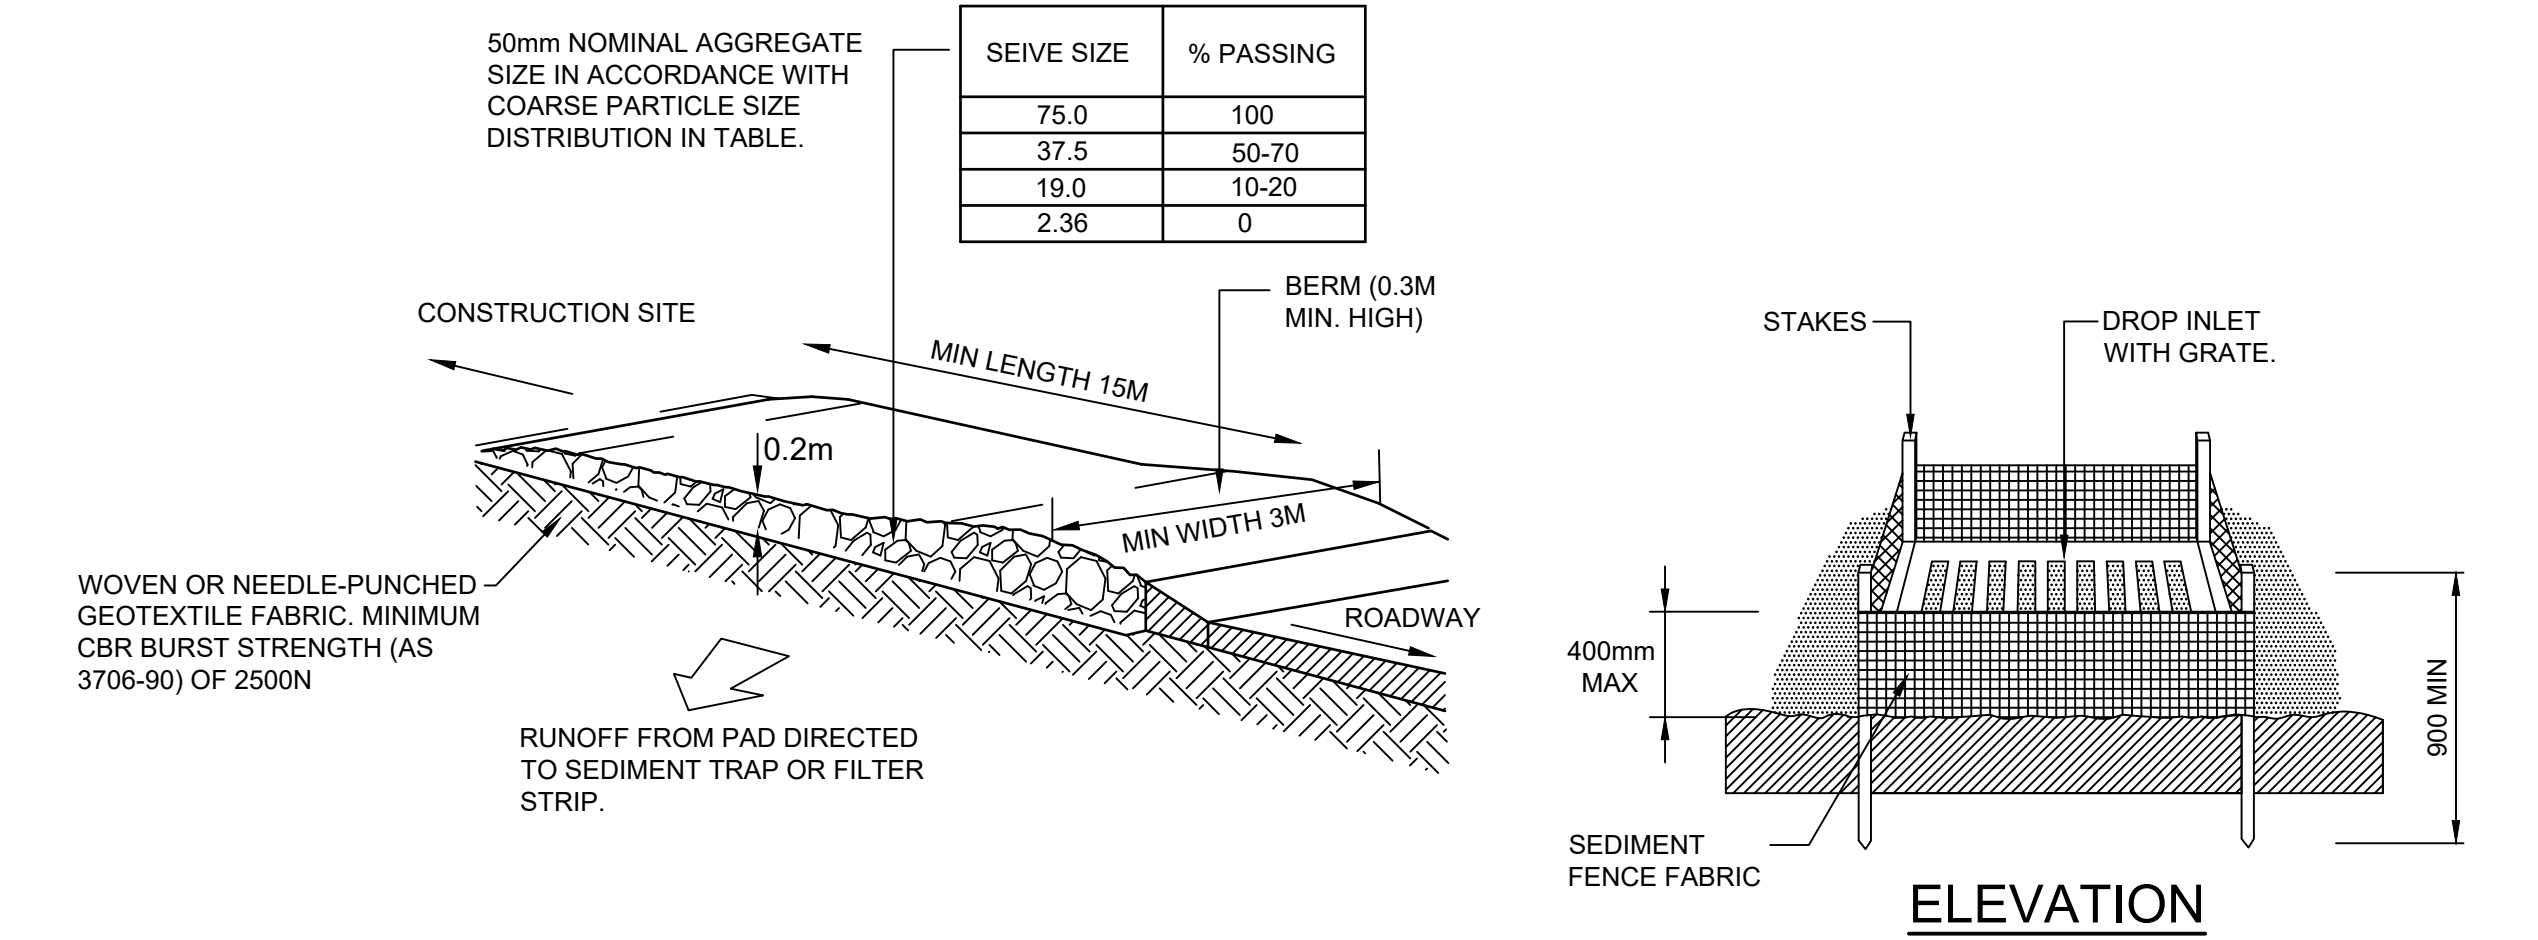


TEMPORARY STABILISED SITE ENTRY/EXIT (ROCK)


SCALE N.T.S.

NOTES:


1. STABILISED ACCESS SHOULD BE CLEANED AND MAINTAINED AFTER EVERY RAINFALL EVENT (>5mm) AND WHEN SEDIMENT ACCUMULATION IS NOTED.
2. FINE ACCUMULATED SEDIMENTS SHOULD BE REMOVED FROM AGGREGATE REGULARLY.

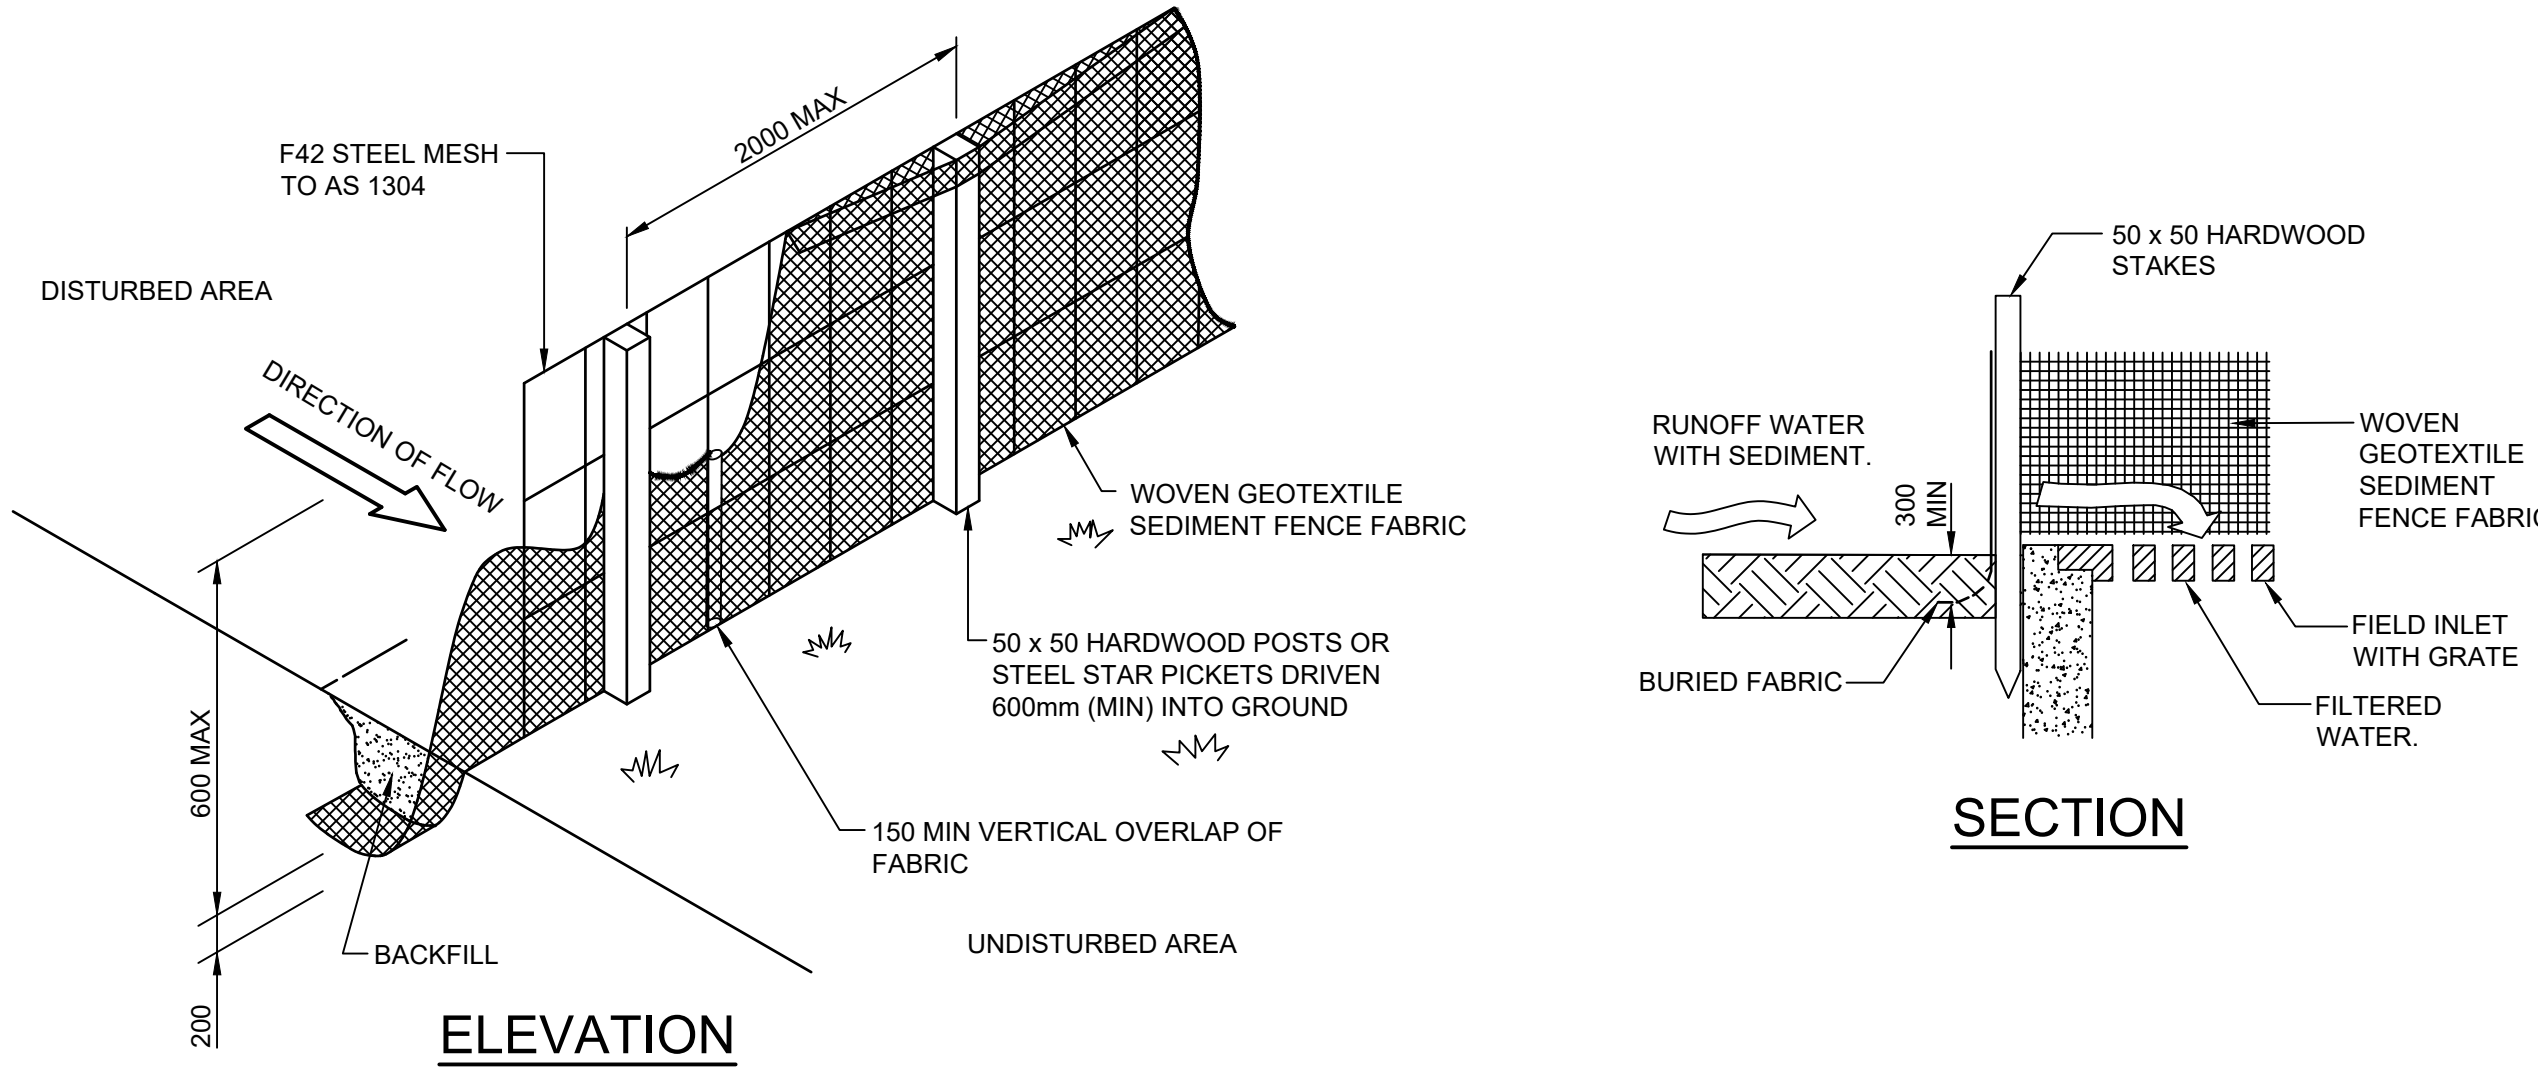

ELEVATION

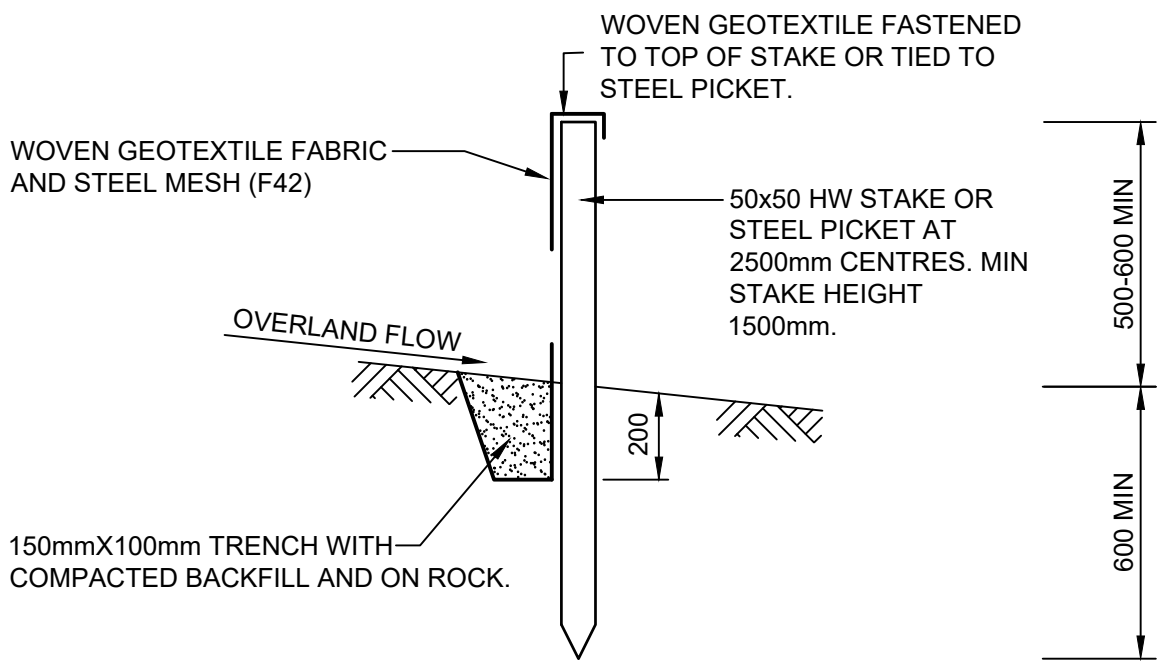


SECTION DETAIL

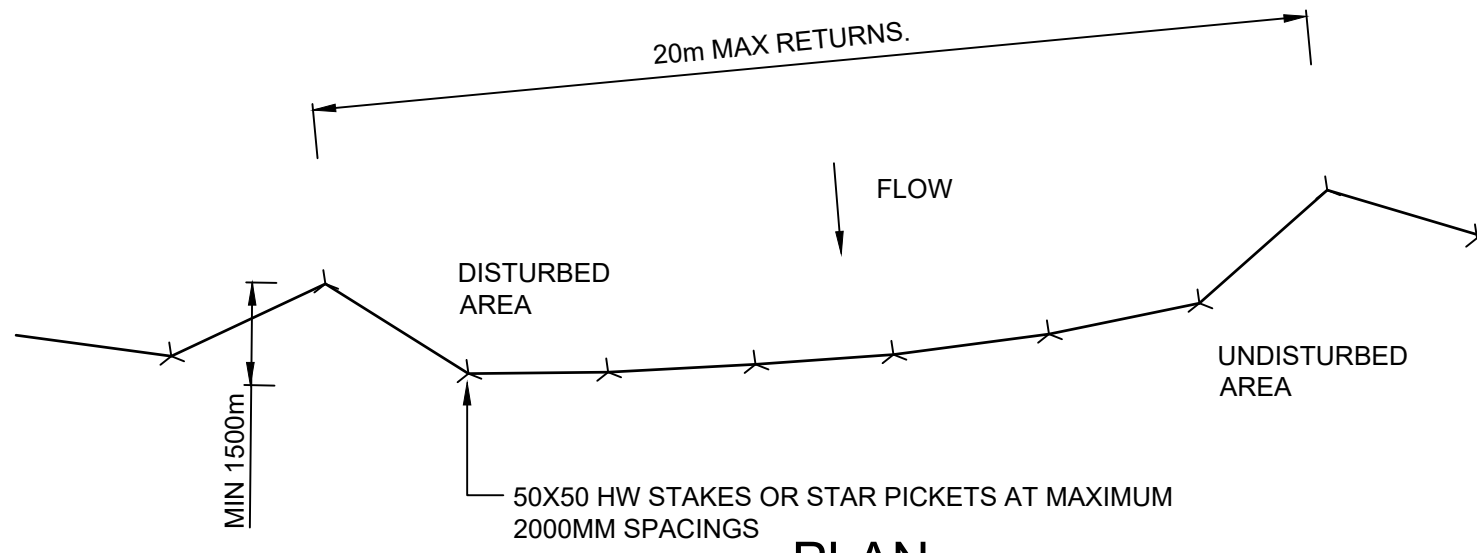


SEDIMENT FENCE DETAIL

SCALE N.T.S.

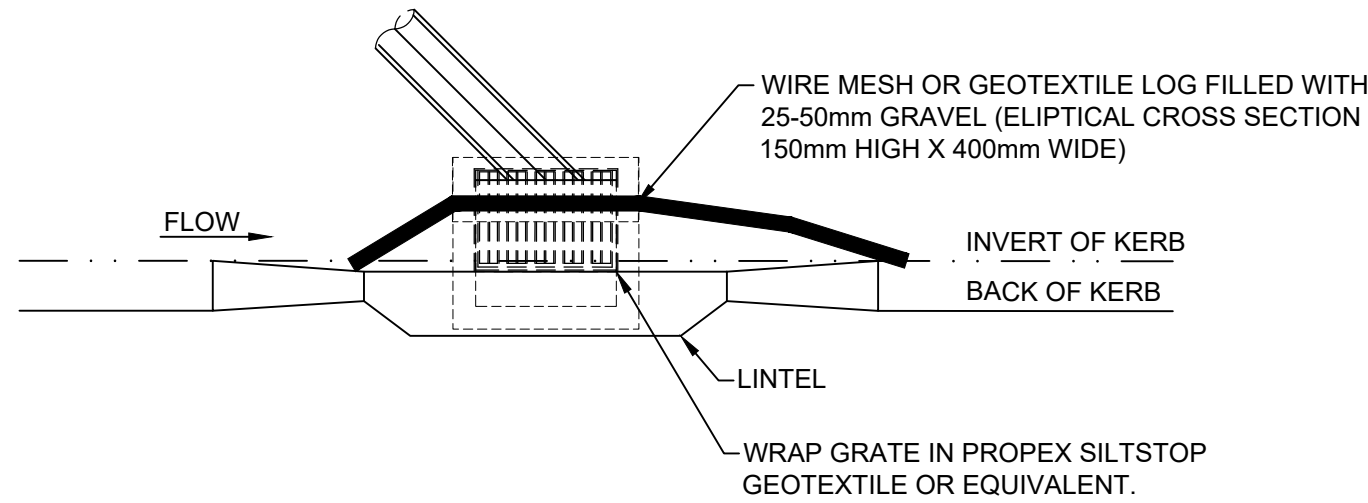

TEMPORARY GULLY PROTECTION DETAIL (SAG)

SCALE N.T.S.

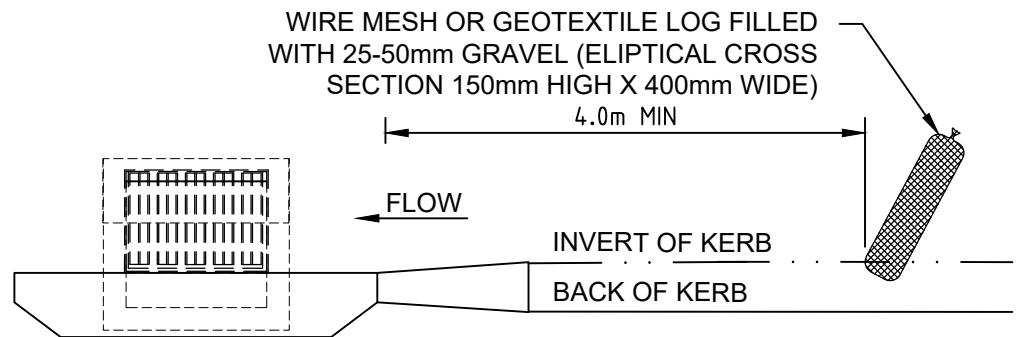

TEMPORARY GULLY PROTECTION DETAIL (ON GRADE)

SCALE N.T.S.

FOR CONSTRUCTION


THIS PLAN IS TO BE PRINTED IN COLOUR

© COPYRIGHT of this design and plan is the property of ACOR Consultants (Qld) Pty Ltd, ACN 126 011 087 ABN 18 126 011 087, all rights reserved. It must not be used, modified, reproduced or copied wholly or in part without written permission from ACOR Consultants (Qld) Pty Ltd. ACOR Consultants is a trademark licensed to ACOR Consultants (Qld) Pty Ltd by ACOR Consultants Pty Ltd.

Issue	Description	Date	Drawn	Approved
1	ISSUE FOR CONSTRUCTION	21/06/22	JG	ND
B	FOR APPROVAL	15/02/22	JG	ND
A	TENDER ISSUE	24/11/21	JG	ND
P1	SCHEMATIC DESIGN	22/06/21	LM	ND

1cm at full size

20cm




ENGINEER'S CERTIFICATION
This drawing has been assigned an electronic code that signifies the drawing has been checked and approved by:



ACOR Consultants (Qld) Pty Ltd
Level 7, 22 Cordelia Street
South Brisbane QLD 4101
T +61 7 3844 5900

Project
ROCKPOOL AGED CARE PELICAN WATERS
LOT 90, SPITFIRE BANKS DRIVE
PELICAN WATERS, QLD

Drawing Title					
EROSION AND SEDIMENT CONTROL DETAILS					
Drawn	Date	Scale	A1	Q.A. Check	Date
JG	22/10/21	N.T.S		ND	15/02/22
Designed	Project No.	Dwg. No.		Issue	
ND	BR210085	21033-C-1.01		1	

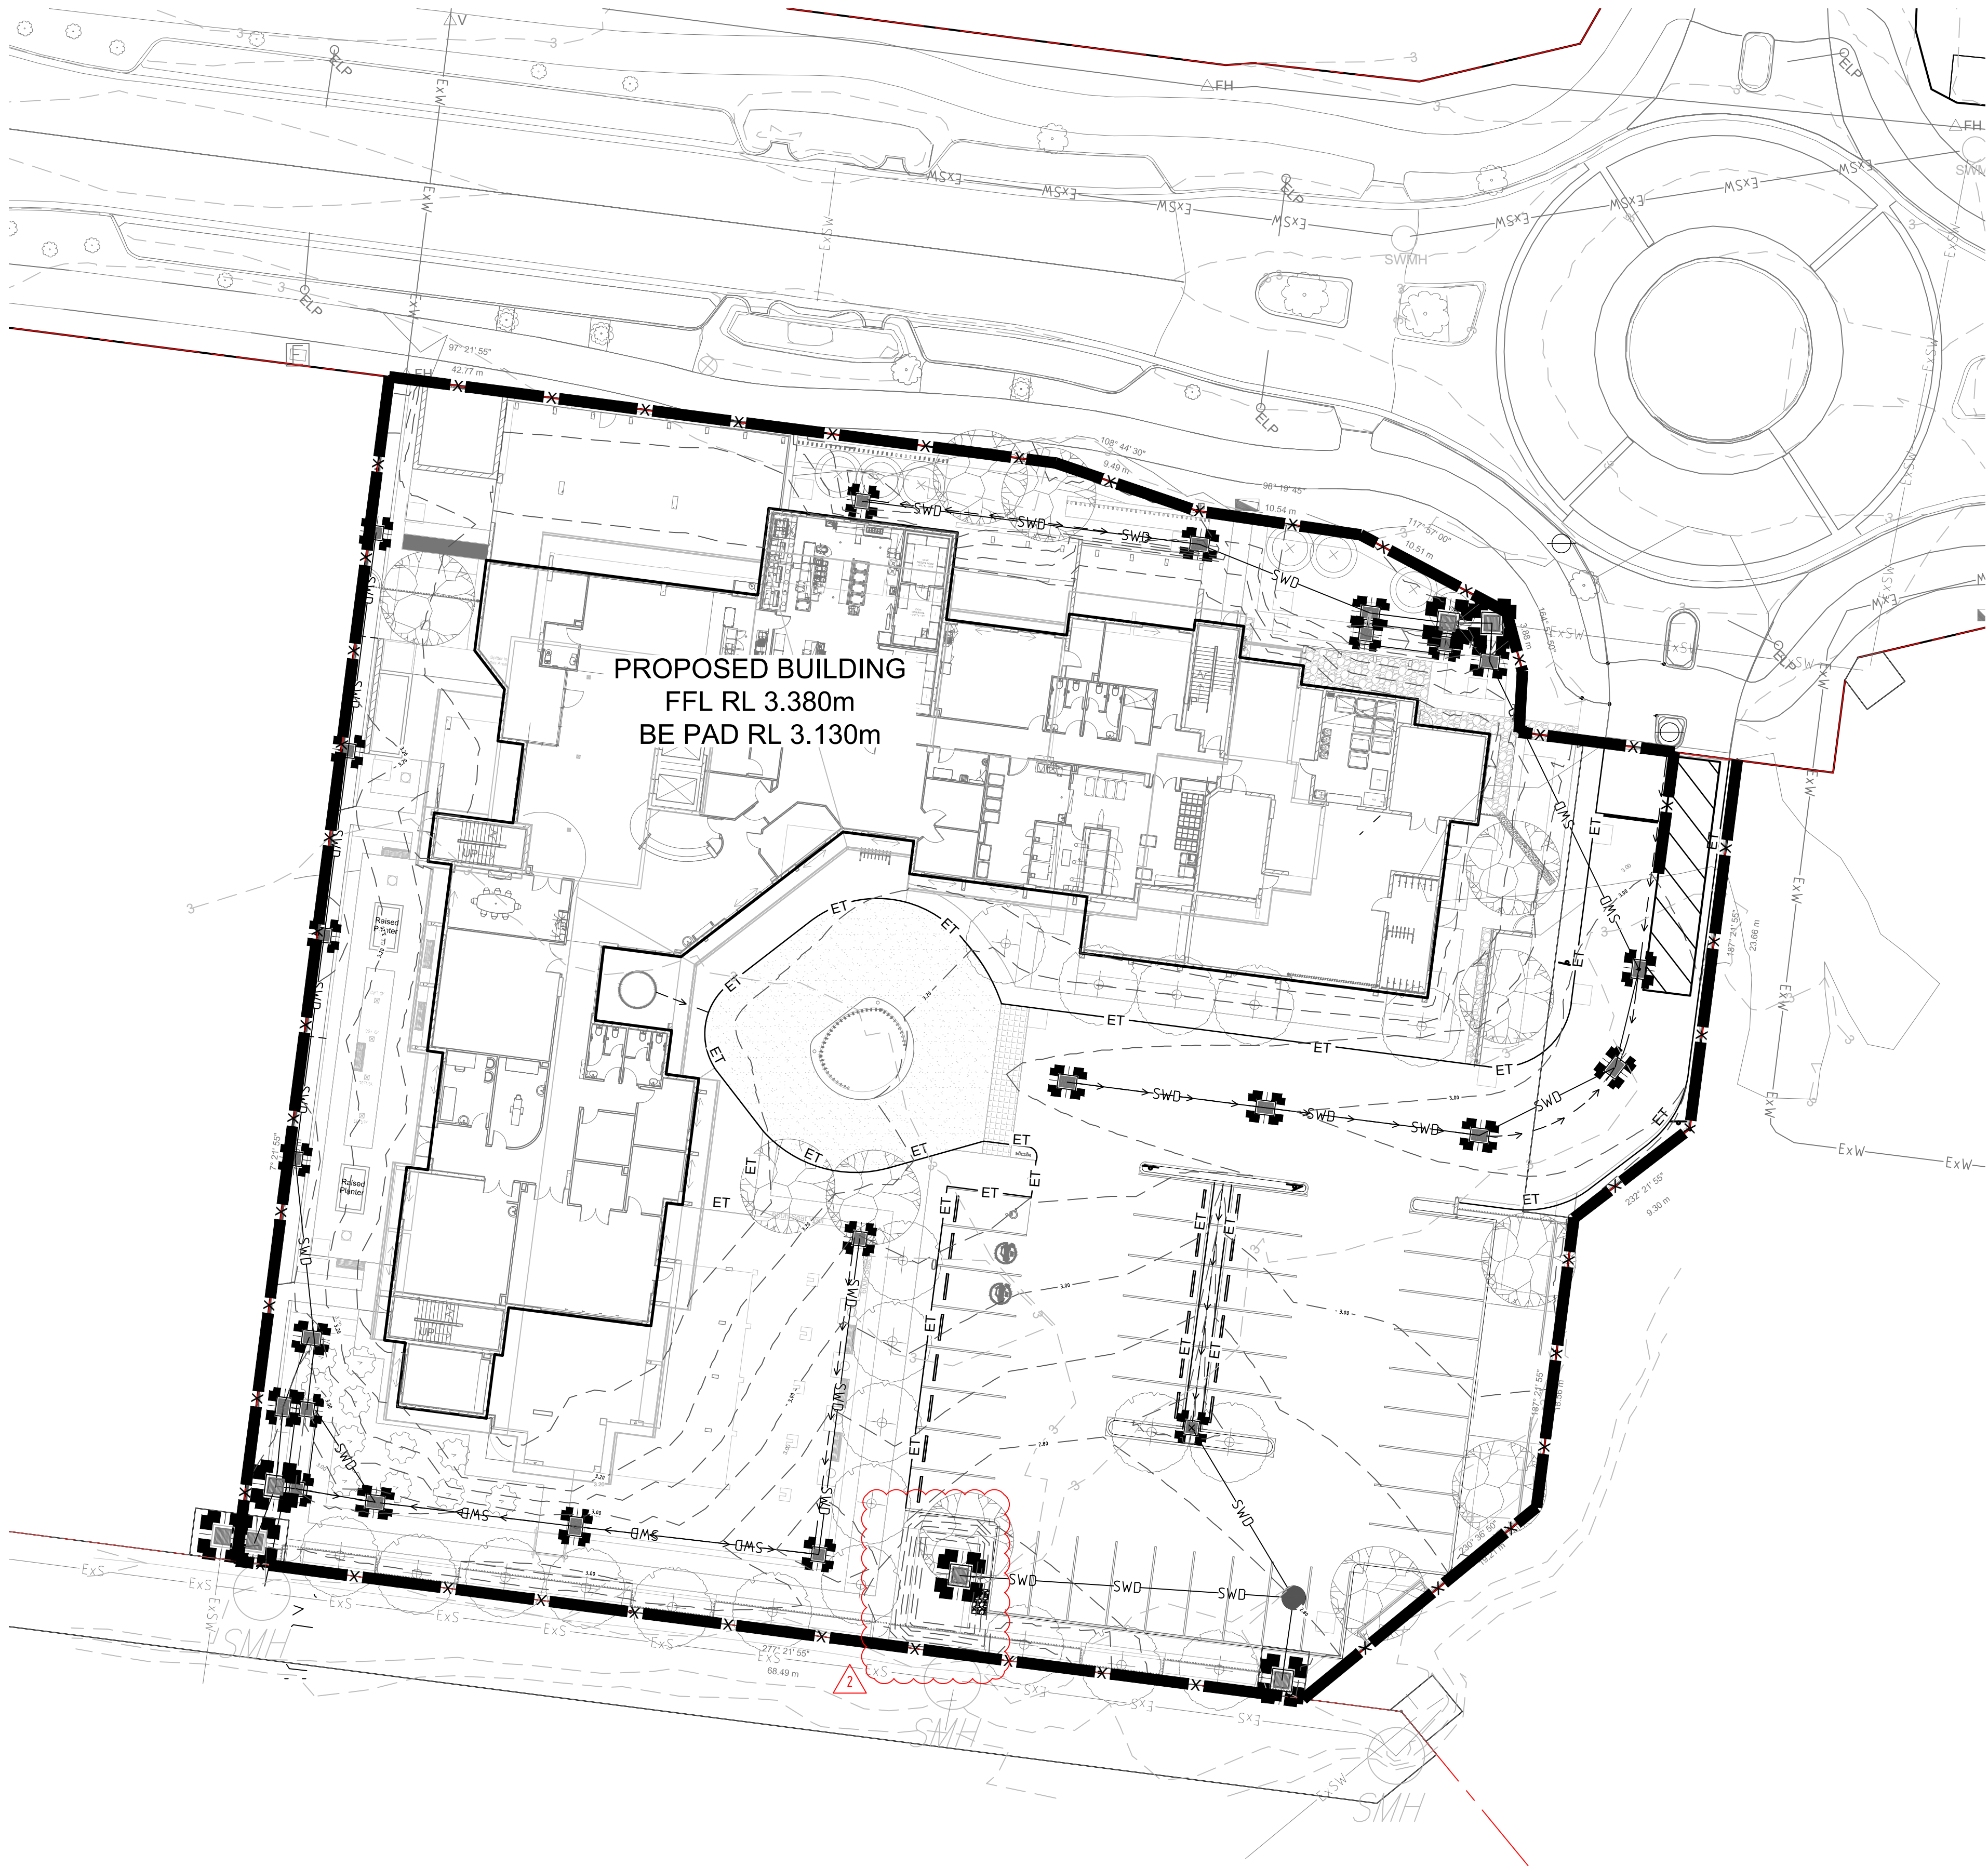

LEGEND

- PROPOSED TEMPORARY STABILISED SITE ENTRY/EXIT - REFER EROSION AND SEDIMENT CONTROL DETAIL SHEET C-1.01.
- FINAL LOCATION TO BE DETERMINED BY THE CONTRACTOR
- PROPOSED SEDIMENT FENCE - REFER EROSION AND SEDIMENT CONTROL DETAIL SHEET C-1.01
- PROPOSED TEMPORARY GEOTEXTILE FILTER FABRIC DROP INLET SEDIMENT TRAP - REFER EROSION AND SEDIMENT CONTROL DETAIL SHEET C-1.01
- PROPOSED TEMPORARY GULLY TRAP - REFER EROSION AND SEDIMENT CONTROL DETAIL SHEET C-1.01
- PROPOSED TEMPORARY CHANNEL TRAP - REFER EROSION AND SEDIMENT CONTROL DETAIL SHEET C-1.01
- PROPOSED SURFACE CONTOUR (0.05m INTERVAL)
- REFER NOTE 1 FOR DETAILS

EXISTING SERVICES LEGEND

- DEVELOPMENT BOUNDARY
- EXISTING CONTOUR (0.05m INTERVAL)
- EXISTING STORMWATER
- EXISTING SEWER
- EXISTING WATER
- EXISTING GAS
- EXISTING ELECTRICAL - UNDERGROUND
- EXISTING TELECOMMUNICATIONS
- EXISTING EARTHWORKS TOP OF BATTER
- EXISTING EARTHWORKS TOE OF BATTER
- EXISTING FENCE
- EXISTING SERVICE TO BE MADE REDUNDANT

NOTES

- GRAVEL SHAKE DOWN AND WASH DOWN AREA. DISCHARGE TO SUITABLE SEDIMENT CAPTURE DEVICE. FINAL LOCATION TO BE DETERMINED BY THE CONTRACTOR.
- SEDIMENT FENCES MUST BE LOCATED PARALLEL TO SUIT CONTOURS AT A MAXIMUM LENGTH OF 50m.
- TURNOUTS ARE TO BE INCORPORATED TO PREVENT CONCENTRATION OF FLOWS.
- CONTRACTOR TO PROVIDE ROAD GULLY PROTECTION TO ALL DOWNSTREAM ROAD GULLIES ON INTERNAL ROAD.

IMPORTANT

SEDIMENT AND CONTROL MEASURES SHOWN ON THIS PLAN ARE PREPARED AS A GUIDE FOR CONSTRUCTION APPROVAL BY COUNCIL. IT DOES NOT IN ANY WAY RELIEVE THE CONTRACTOR OF HIS RESPONSIBILITY TO PLAN AND IMPLEMENT ENVIRONMENTAL PROTECTION MEASURES AS REQUIRED BY LAW, THE COUNCIL AND THE CONTRACT THROUGHOUT THE WORKS.


0 2 4 6 8 10 12m
SCALE 1:250 @ A1

FOR CONSTRUCTION

THIS PLAN IS TO BE
PRINTED IN COLOUR

© COPYRIGHT of this design and plan is the property of ACOR Consultants (Qld) Pty Ltd, ACN 126 011 087 ABN 18 126 011 087, all rights reserved. It must not be used, modified, reproduced or copied wholly or in part without written permission from ACOR Consultants (Qld) Pty Ltd. ACOR Consultants is a trademark licensed to ACOR Consultants (Qld) Pty Ltd by ACOR Consultants Pty Ltd.

2	RELOCATION OF PIT 113	10/10/22	ND	ND
1	ISSUE FOR CONSTRUCTION	21/06/22	JG	ND
B	FOR APPROVAL	15/02/22	JG	ND
A	TENDER ISSUE	24/11/21	JG	ND
P1	SCHEMATIC DESIGN	22/06/21	LM	ND
Issue	Description	Date	Drawn	Approved
1				



ENGINEER'S CERTIFICATION
This drawing has been assigned an electronic code that signifies the drawing has been checked and approved by:



ACOR Consultants (Qld) Pty Ltd
Level 7, 22 Cordelia Street
South Brisbane QLD 4101
T +61 7 3844 5900

**ROCKPOOL AGED CARE
PELICAN WATERS**
LOT 90, SPITFIRE BANKS DRIVE
PELICAN WATERS, QLD

Drawing Title EROSION AND SEDIMENT CONTROL PLAN					
Drawn LM	Date 22/10/21	Scale 1:250	A1	Q.A. Check ND	Date 10/10/22
Designed ND	Project No. BR210085	Dwg. No. 21033-C-1.02	Issue 2		